



Wall-Mounted Cooler



Standard finish is Platinum Vinyl

Optional Finishes (no extra cost)

- Slate
- Almond

Optional Finishes (extra cost)

- All Stainless Steel

Optional Accessories (extra cost)

- Glass Filler
- Vandal-Resistant Kit
- Water Filter
- Easy-Flex™ Bubbler

Trap and service stop not included.

JOB NAME: _____

ENGINEER/CONTRACTOR NAME: _____

APPROVAL: _____

DATE: _____

MODEL: SW4A-Q SW8A-Q
 SW14A-Q SW L/R (Less Refrigeration)



These water coolers are certified to NSF/ANSI 61.

GENERAL

Self-contained, electric refrigerated, wall-mounted water cooler designed to be easily accessible to able-bodied individuals. Unit is certified to NSF/ANSI 61 and meets requirements of the Safe Drinking Water Act. Unit provides 50° F water at 80° F inlet water and 90° F ambient.

CABINET

Heavy-gauge vinyl clad steel. Resistant to wear, moisture, perspiration, heat and sunlight. Optional Stainless Steel is available.

COOLER TOP

Non-corrosive stainless steel cooler top, number 300 series with satin finish resists stains and corrosion and is easy to maintain. Anti-splash ridge reduces splatter. Contoured to insure proper drainage.

BUBBLER

Exclusive one-piece, chrome-plated two-stream mound-building bubbler with non-removable anti-squirt feature and integral hood insures a satisfying drink of water.

PUSHBUTTON ACTUATION MECHANISM

Self closing, vandal-resistant pushbutton does not require grasping or twisting.

AUTOMATIC STREAM HEIGHT REGULATOR

Self-closing assembly is located inside unit to prevent tampering. Unit resists corrosion and liming. A constant stream height is automatically maintained under line pressures that vary from 20 to 105 psi.

INLET STRAINER

Easily cleaned in-line strainer screen traps particles of 140 microns or larger before they enter the waterway.

TEMPERATURE CONTROL

Positive sensing thermostat for controlling temperature of storage tank water. Factory set at 50° F Adjustable ±5° F.

STORAGE TANK

Non-pressurized stainless steel evaporator/storage tank for long life. Waterways are certified to NSF/ANSI 61, far exceeding the requirements of the Safe Drinking Water Act.

REFRIGERATION SYSTEM

Hermetically sealed, positive start compressor with lifetime lubrication and built-in overload protection, efficient capillary sizing, large capacity dryer-strainer, and fan cooled copper/aluminum condenser with self-lubricated bearing. System uses R134A refrigerant. Protected by Halsey Taylor's Limited 5 Year Warranty.

VENTILATION

Insure proper ventilation by maintaining 6" (152mm) minimum clearance from cabinet louvers to wall.

SUGGESTED SPECIFICATIONS

Shall deliver () GPH of 50° F water at 90° F ambient and 80° F inlet water. Shall have stainless steel basin with removable drain strainer. Bubbler shall be two-stream, mound-building type. Separate valve and automatic stream regulator shall be mounted within cabinet. Refrigeration system shall employ high efficiency, positive start compressor using R134A non-pressurized tank with totally encapsulated insulation and be controlled by positive sensing thermostat. The manufacturer shall certify the unit to meet the requirements of NSF/ANSI 61, and the Safe Drinking Water Act. Unit complies with ARI Standard 1010.

NOTE: Continued product improvement makes specifications subject to change without notice. See Halsey Taylor website for most current spec sheet.

SW SERIES

Model No.	GPH Capacity Cooled to 50° F*				Base Rate Cap.	F.L. Amps	Shipping Weight lb.	Rated Watt Usage
	Ambient Air Temp							
	70°F	80°F	90°F †	100°F				
SW4A-Q	4.8	4.4	4.0	3.6	4.0	2.5	60	230
SW8A-Q	9.2	8.4	7.6	6.8	7.6	4.0	68	370
SW14A-Q	16.8	15.4	13.5	12.6	13.5	7.5	70	690

* With projector service and tap water at 80° F

† UL listed and complies with ARI Standard 1010



SW4A-Q, SW8A-Q, SW14A-Q, SW L/R

Compact Wall-Mounted Cooler

(CONTINUED)

MOUNTING HEIGHT

Adult mounting height recommended 40" from basin to floor. May be mounted at any desired height.

MOUNTING INSTRUCTIONS

Mount trap and install service stop to building supply line. Anchor hanger bracket securely to wall on all sides. To insure proper engaging of waste line into trap, centerline of trap must be 6 1/4" from wall face.

Remove slip nut and gasket from trap and install on waste line tube. Hang cooler on bracket and engage waste line tube into trap inlet. Centerline height of waste outlet is 22 1/2" from floor line for conventional adult installation.

PLUMBING CONNECTIONS

Enter directly into cabinet. Waste 1 1/4" O.D. slip connection. Supply 3/8" tubing.

Trap and service stop not included.

OPERATING PRESSURES:


Supply water-105 psi maximum

ELECTRICAL

Furnished with plug-in, 3-wire grounding type service cord. Standard 120 volt, 60 Hz, single phase. Install 120 volt receptacle, rated at 15-amp minimum, to receive 3-wire parallel blade grounding type male plug.

FRONT VIEW / WALL LAYOUT

SIDE VIEW

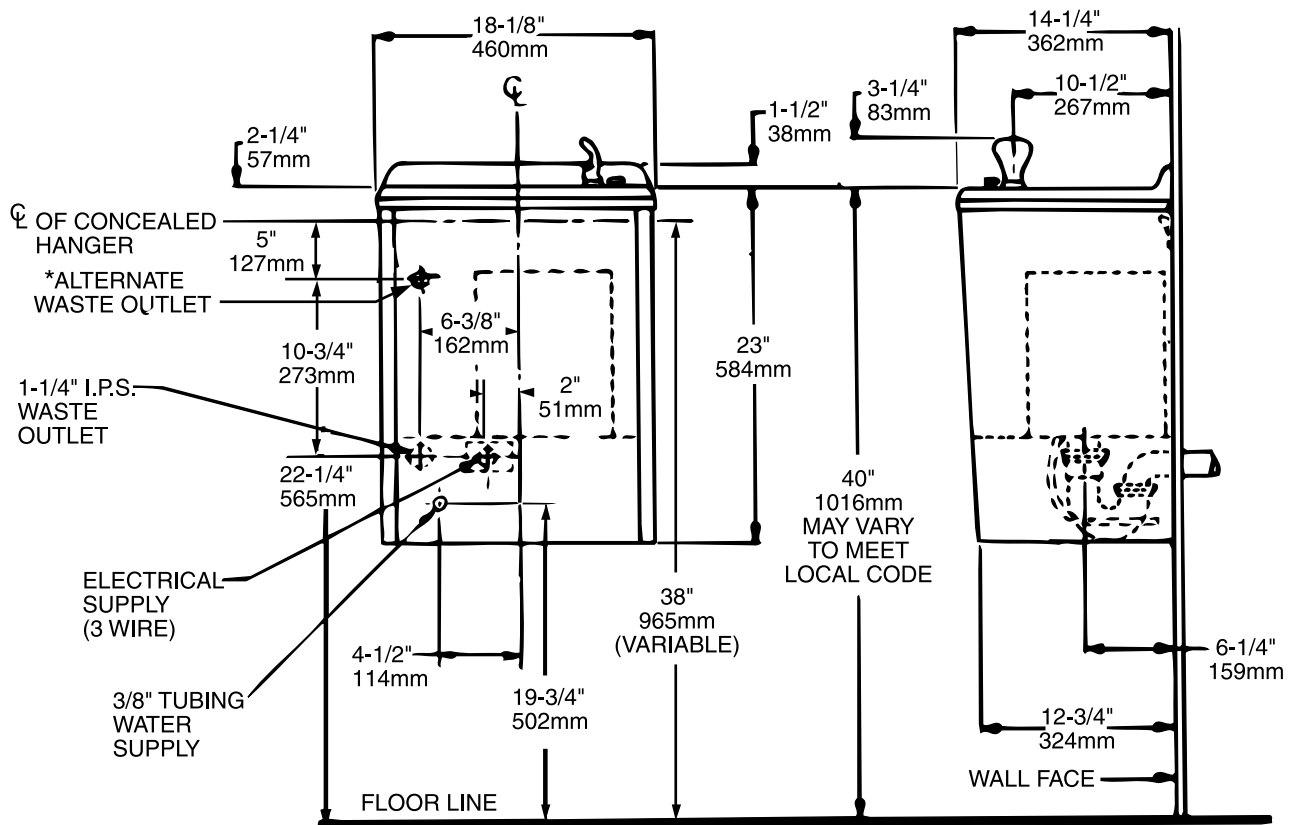

NOTE: Optional holes may be added to back panel to secure bottom of cooler to wall. Minimum wall clearance for air flow is 4 inches (102mm) on either side.

NOTE: A service supply stop must be installed at the cooler inlet line.

*Alternate location for waste outlet provides improved access but requires tailpiece to be shortened.

1-1/4" Drain trap not included.