

model 6518FR

Faucets and Valves

FEATURES & BENEFITS

SERVICEABILITY

Operation and maintenance ease is achieved through both the adjustable stream regulation and the ability of the valve assembly to be lifted to the surface and lowered back into the casing, so in the rare event that maintenance is required, can be done without having to disturb the fountain.

YEAR-ROUND SERVICE

Reliable and fully engineered system allows the pneumatic valve to be installed below the frost line, and equipped with the ability to drain the water line after use to non-freezing depths so the unit can be used year round.

OPTIONS

To see all options for this model, visit www.hawsco.com




SPECIFICATIONS

Model 6518FR freeze-resistant bury valve for use with single bubbler head pedestal fountains shall include a brass pneumatic operated valve installed below the frost line, check valve to drain water from unit when not in use and to prevent back-flow cross contamination, regulator valve, separate valve access and pull-out design for easy maintenance, 6" (15.2 cm) diameter PVC pipe to encase valve assembly, and 1/2" IPS supply.

APPLICATIONS

Freeze-resistant valve system is used in all Haws single bubbler, freeze-resistant, pedestal mounted fountains. Because this valve is installed below the frost line, it allows the fountain it is installed with to function year round in freezing conditions. Responsible for this non-freezing feat is a pneumatic operated valve that drains the water from the fountain to non-freezing depths. Product is compliant to California Health and Safety Code 116875 (AB 1953-2006).



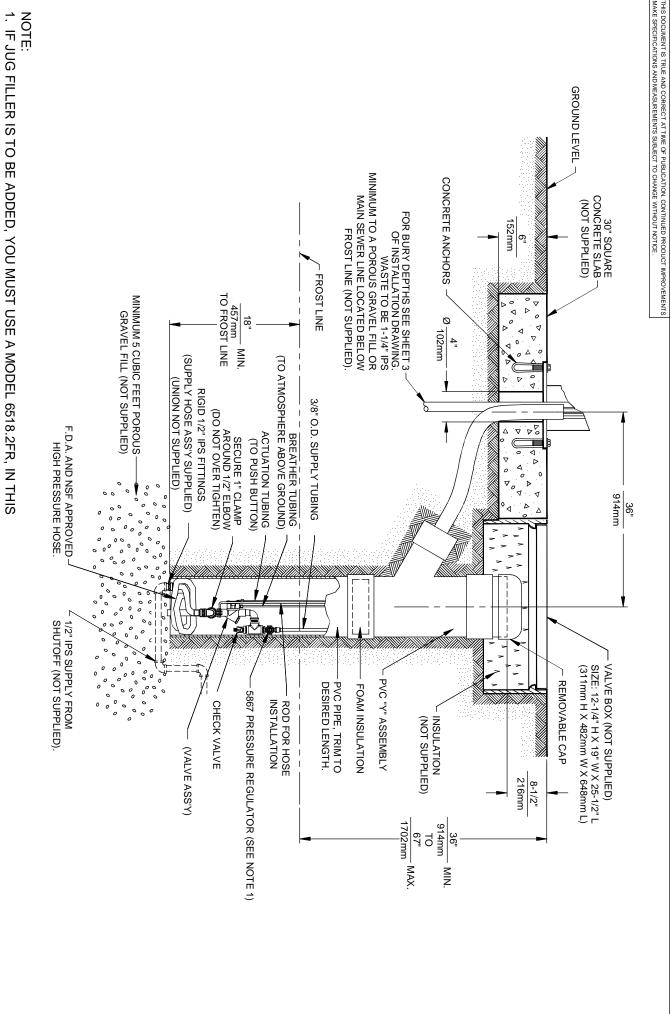

©2012 Haws Corporation - All Rights Reserved

HAWS® and other trademarks used in these materials are the exclusive property of Haws Corporation

DRAWN: TRF

DATE: CHK'D.:

6518FR MODEL(S)

1455 KLEPPE LANE
SPARKS, NEVADA 89431
(775) 359-4712 FAX (775) 359-7424
E-MAIL: HAWS @HAWSCO.COM
WEBSITE: WWW.HAWSCO.COM


0002077777.D ART NUMBER:

VALVE, FREEZE RESISTANT, SINGLE SCALE: 1:13 | DRAWING TYPE: INSTALLATION

APPLICATION ANY FLOW CONTROL CONNECTED TO JUG FILLER MUST BE REMOVED.


NO. 08805A00

Page 1 of 3

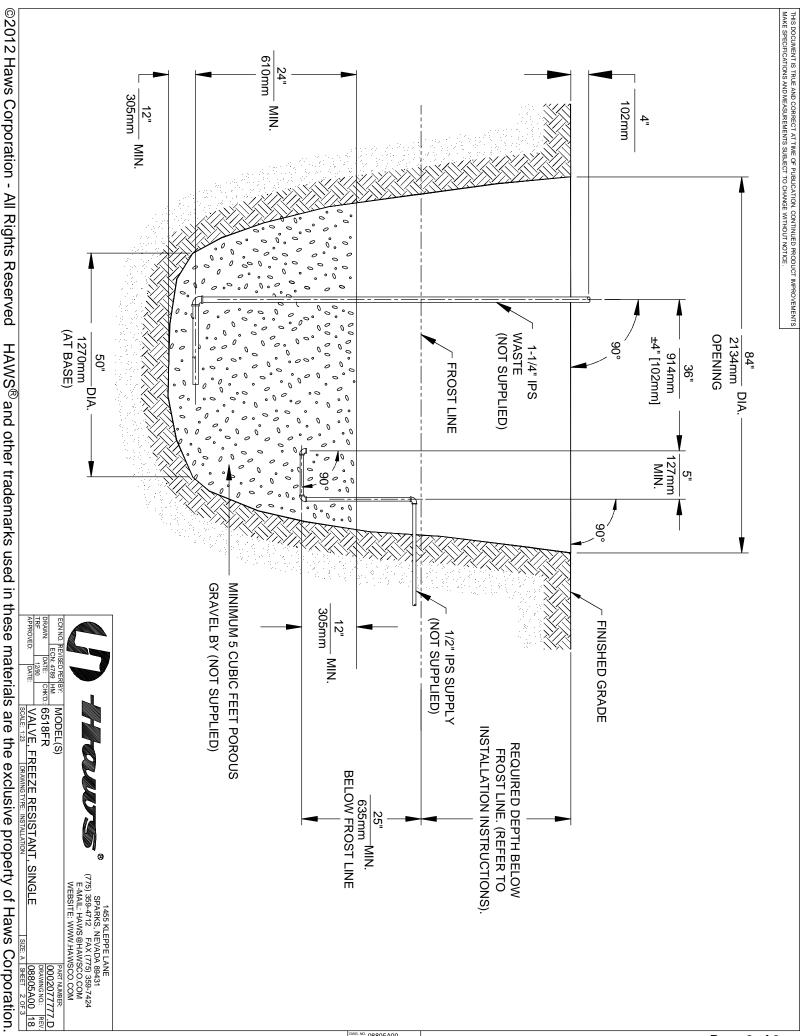

Page 2 of 3

DWG. NO. 08805A00

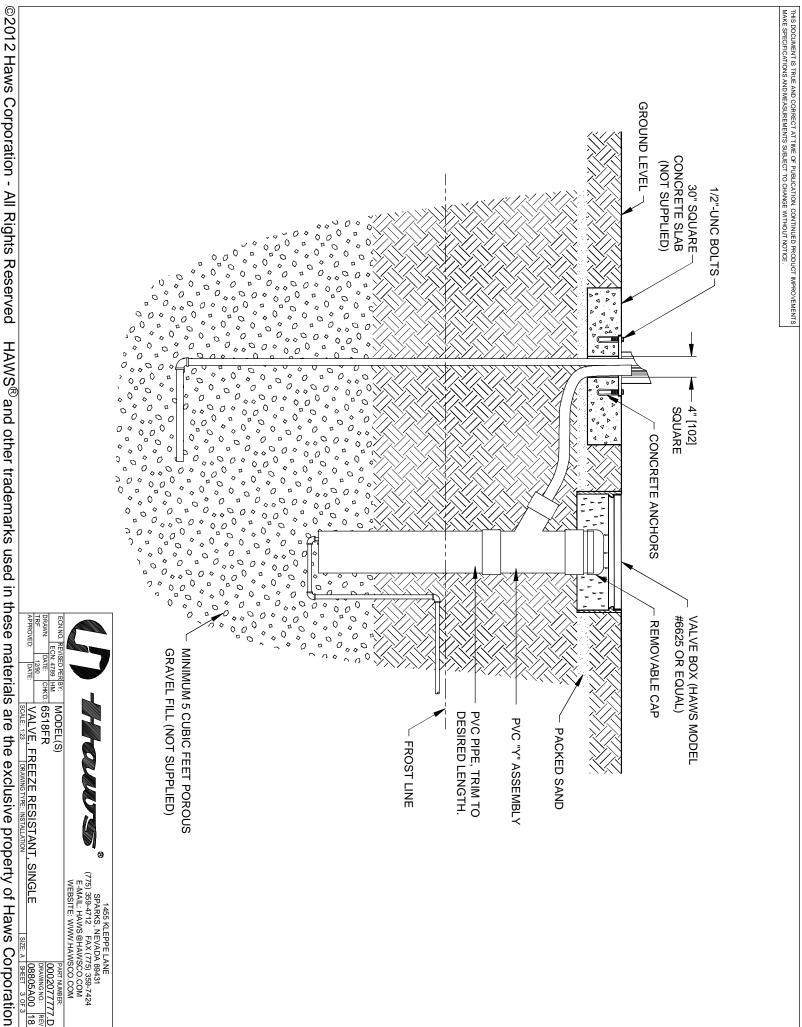

NO. 08805A00

Page 3 of 3