



model 8317IDLTEXP

Indicator Light

FEATURES & BENEFITS

OPTIONS

For more information, visit www.hawesco.com or call (888) 640-4297.



SPECIFICATIONS

Model 8317IDLTEXP is an indicator light kit for the 8317CTFP series showers. When lit, the light indicates power is being supplied to heat traced cable on model. Model is CSA electrical certified, TYPE 4. For Class 1, Div. 2, Group B, C & D. Tempering code T6; only when used with 8317CTFP.



APPLICATIONS

Model is CSA electrical certified, TYPE 4. For Class 1, Div. 2, Group B, C & D - Tempering code T6; only when used with 8317CTFP.



NOTES:

1. THERMOSTAT IS HERMETICALLY SEALED. INDICATOR LIGHT IS NON ARCING DEVICE WITH GASKETED JUNCTION BOX SUITABLE FOR CLASS I, DIVISION 2, GROUP B,C,D AREAS BUT NOT SUITABLE FOR DIVISION 1 AREAS.
2. INSTALLER MUST USE THREAD SEALANT SUCH AS APPLETON TLC-3, RECOMMENDED FOR USE IN HAZARDOUS LOCATIONS ON ALL ELECTRICAL NPT CONNECTIONS.

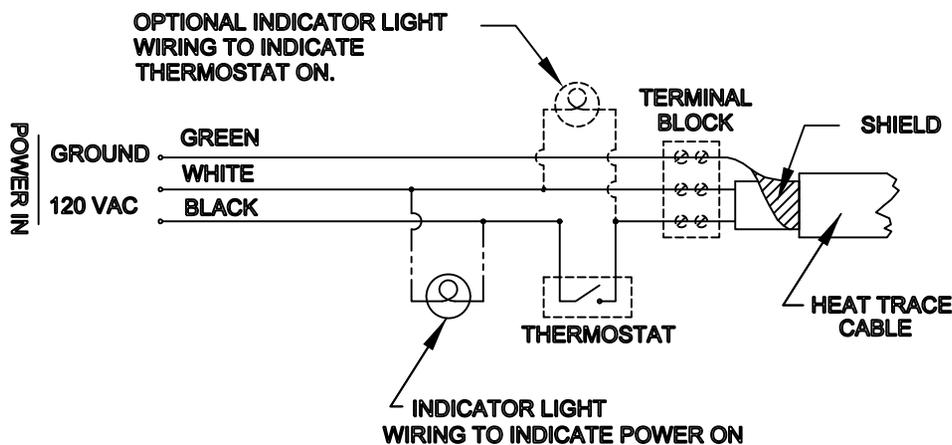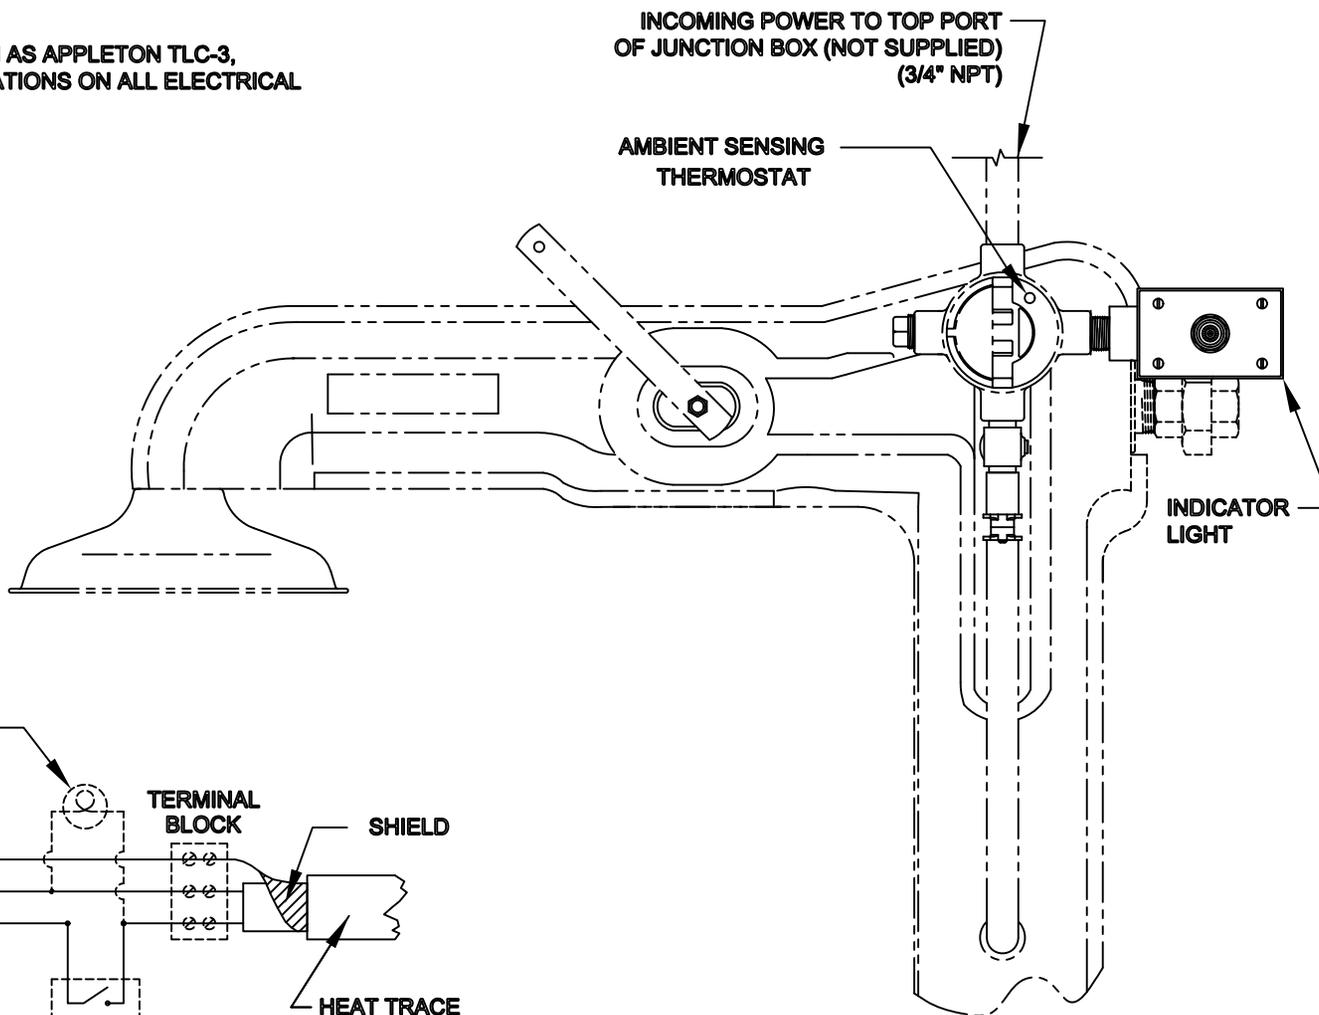

8317 INDICATOR LIGHT KIT INSTALLATION

 Haws corporation		1455 KLEPPE LANE SPARKS, NEVADA 89431 (775) 359-4712 FAX (775) 359-7424 E-MAIL: HAWS@HAWS.CO.COM WEBSITE: WWW.HAWS.CO.COM	
		MODEL(S): INDICATOR LIGHT 8317IDLFXP INFO FAX DOC #: 283174358397	PART NUMBER: 0002080159 DRAWING RELEASED: 08441A00
ECN: 4301 DATE: 02/90	DATE: 02/90	SCALE: 1/8 DRAWING TYPE: INSTALLATION/FABRICATION	SHEET 1 OF 1